


Updated on Sunday Dec 8, 2024


https://ccbiiinfo.asc.ohio-state.edu/CCBBI_QA.csv

https://ccbiiinfo.asc.ohio-state.edu/DailyQA_procedure.pdf


SNR

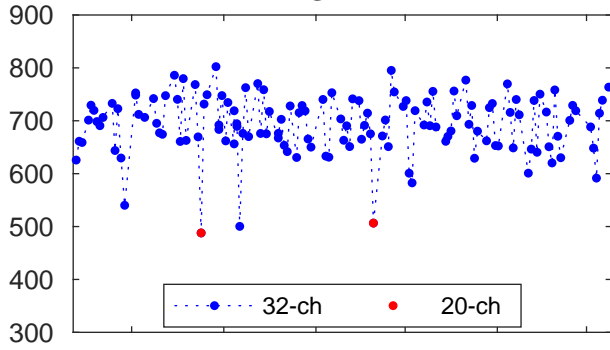


Frequency around 123.236 MHz

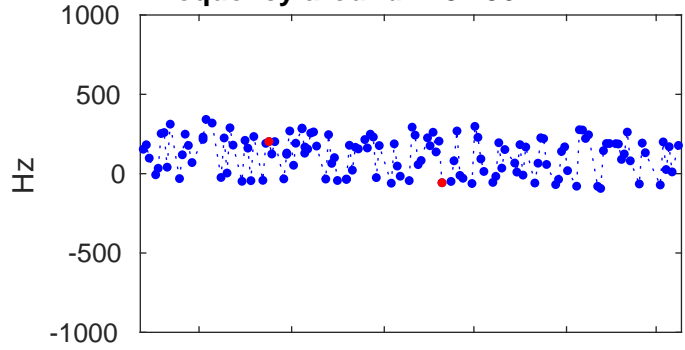


Ghost

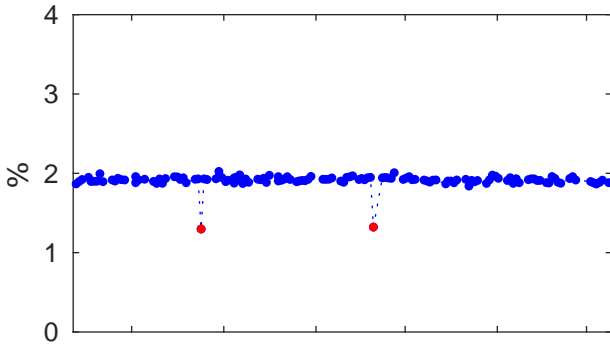


Helium Level

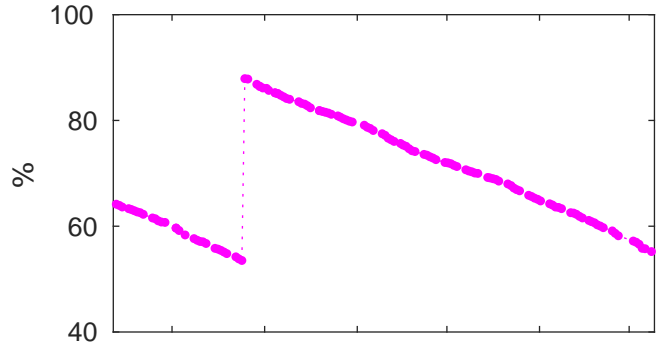


Drift

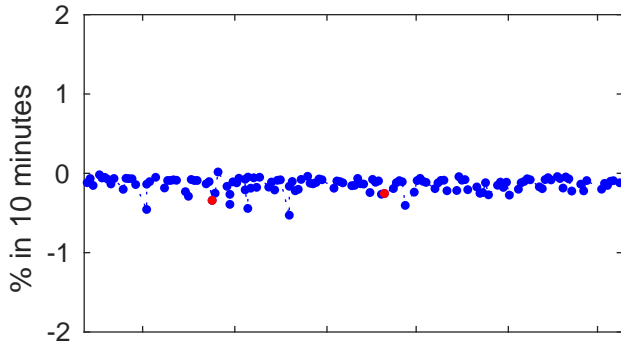

Primary Water Temperature

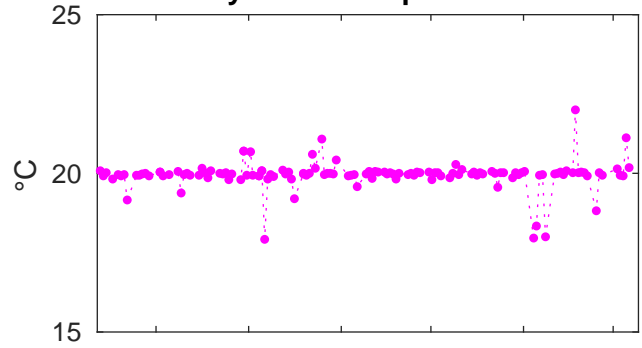

TX Coil Reference Amplitude

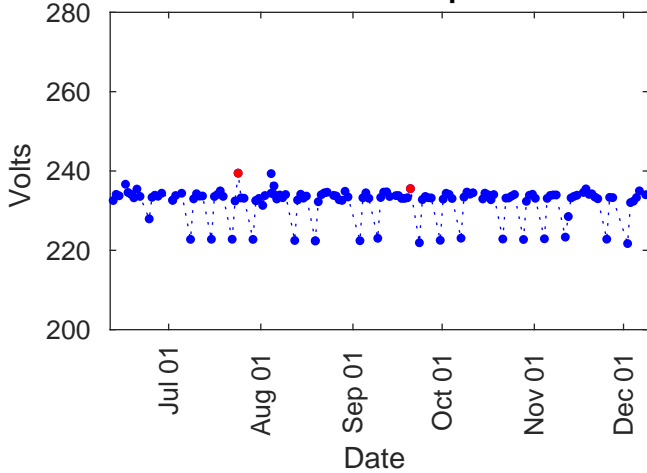

Equipment Room

